



BURKE COUNTY HEALTH DEPARTMENT

☐ IMPROVEMENT PERMIT ONLY

(A BUILDING PERMIT CANNOT BE ISSUED WITH AN IMPROVEMENT PERMIT)

☒ IMPROVEMENT PERMIT AND CONSTRUCTION AUTHORIZATION

PERMIT TYPE: ☒ NEW ☐ EXPANSION ☐ REPAIR

Owner/Agent Robert Hamilton Phone (808) 936-6943 Rec/GIS # 60571  
 Owner/Agent  
 Current Address 500 37th St. SW City Hickory State NC Zip 28602  
 Property/Lot  
 911 Address 1132 Lake Vista Dr. NE City Granite State Zip

Location TOE, TL Malcolm Blvd, TL into SID, TL Lake Vista Dr. NE, lot on right in ~

Subdivision Lake Vista Lot # 8 Total Acreage 1.05ac Water Supply well

SEWAGE SYSTEM DESIGN

☒ House ☐ Mobile Home ☐ Other # Bedrooms 3 # Baths 3.5 # People 6 max

Basement: ☒ Yes ☐ No Basement Plumbing ☒ Yes ☐ No Special Fixtures Distribution box


Design Daily Flow 360gpd L.T.A.R. 0.4 Total Sq. Ft. Drainfield Repair L.T.A.R. 0.5

Tank Size 1000gal Pump Tank Size — Riser(s) Required: ☒ Yes ☐ No

# Trenches 3 Length of Trenches 50' Max. Depth Trench Bottom 24" (lower side)

Type of System III(c) Health Department Insp. Freq. — Management Entity: ☒ Owner ☐ Cert. Operator

Unless otherwise specified, trenches are to be 36" wide 9' apart on centers.

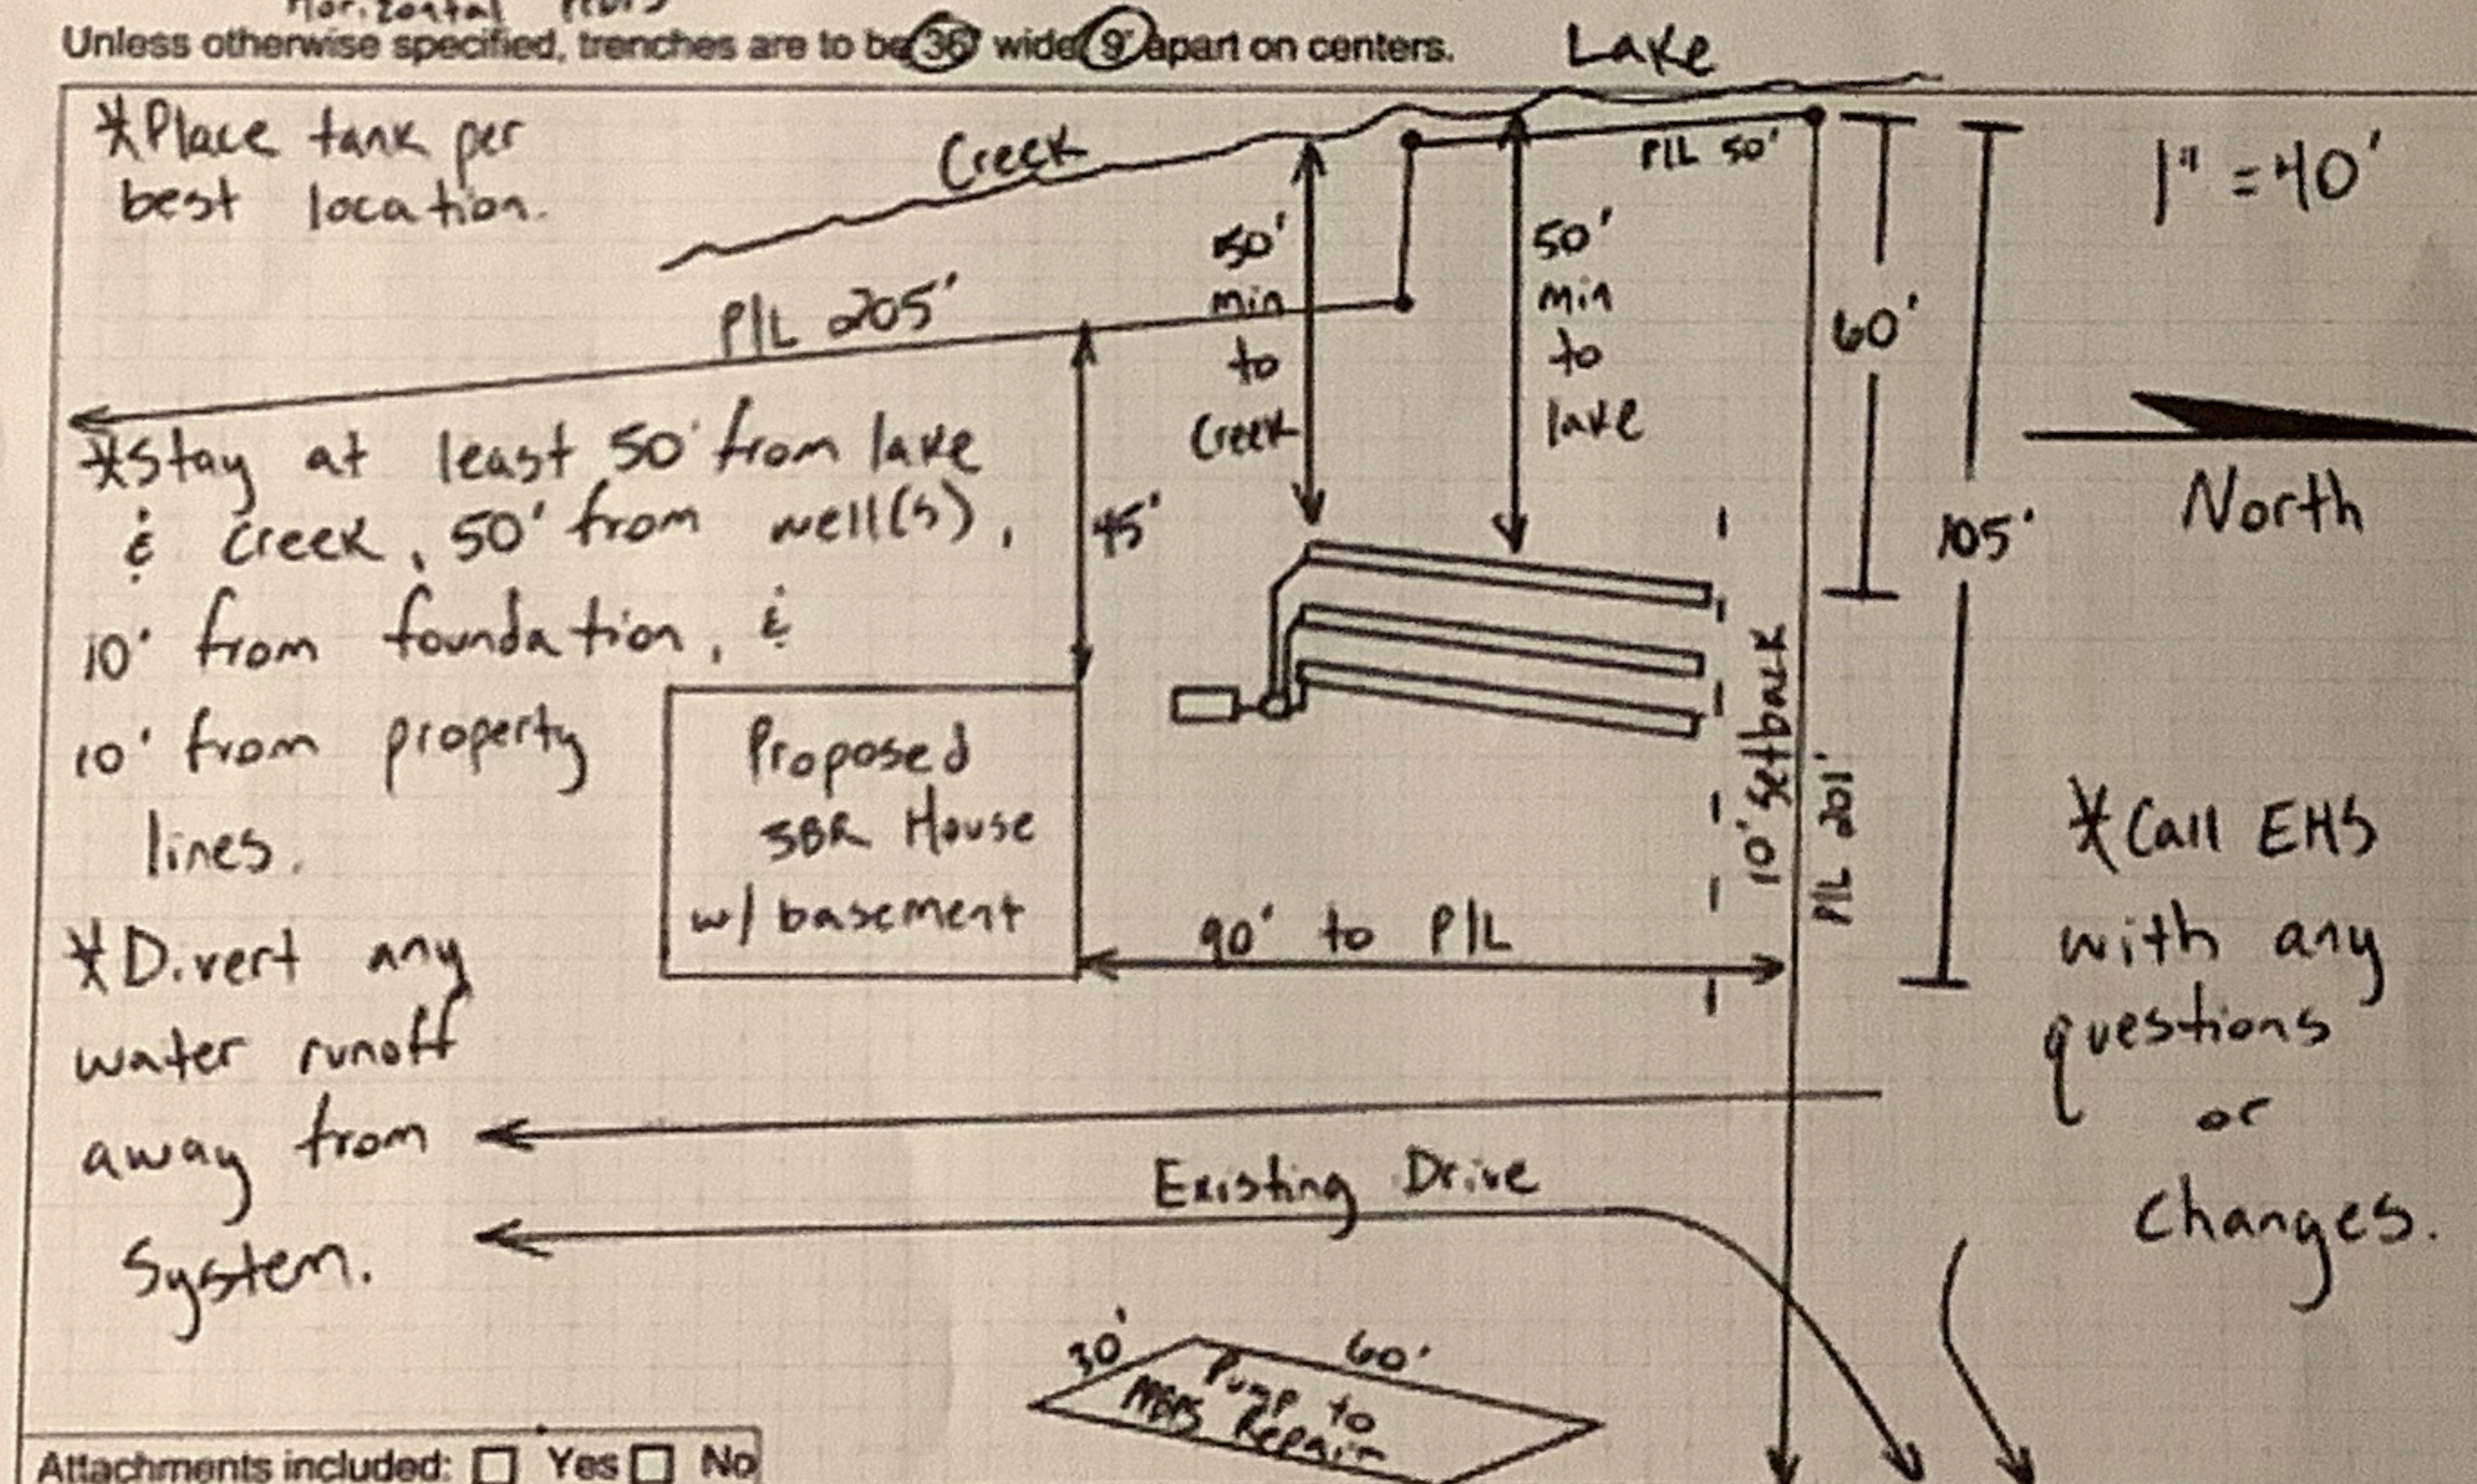

The sewage system must be installed as shown in this permit and be in compliance with all State sewage regulations. You have 30 days from the date of this permit to appeal the permit. Any changes in this design must have prior Health Department approval. This permit expires 5 years (60 months) from the date of issuance. The Environmental Health Office number is (828) 764-9240.


Date of Issuance 10/17/23 Signed Jason Stunt, EHS

Environmental Health Specialist

NAME Robert Hamilton

GIS# 60571

Well Location Site Sketch  
(Environmental Health Specialist use only)

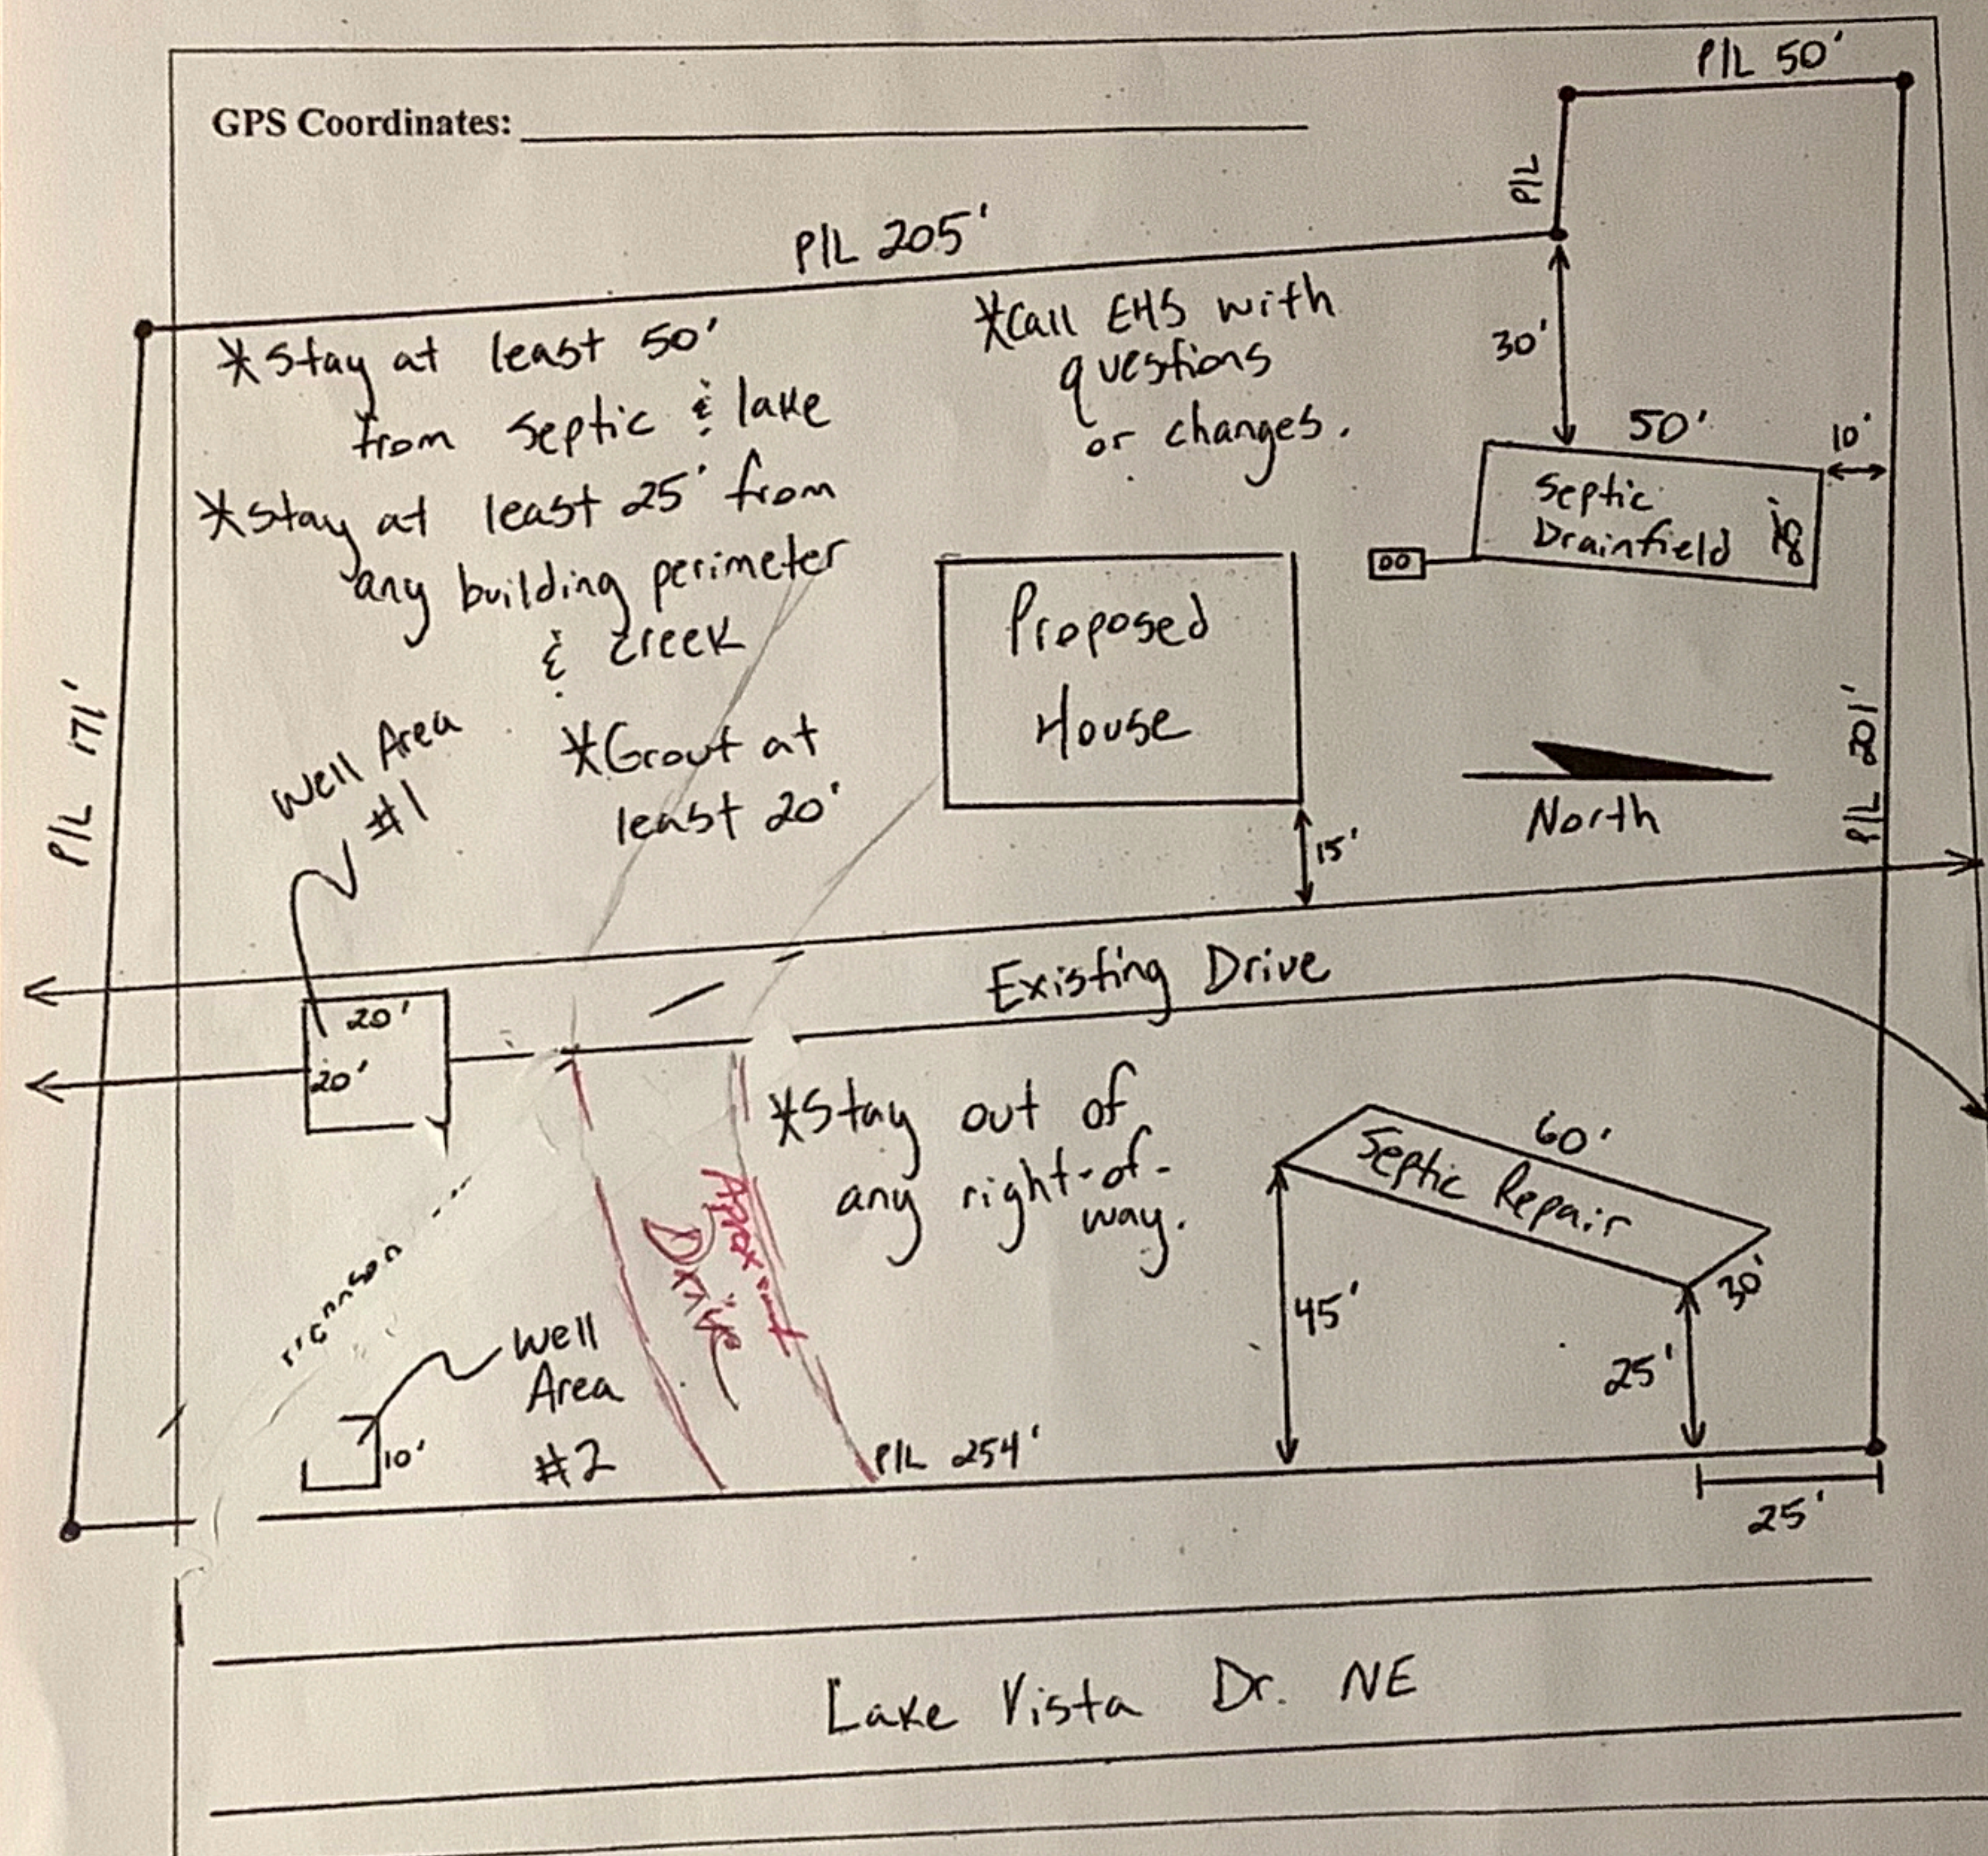

Environmental Health Specialist: Judson Stief, AEHS

Date Issued: 10/17/23